



25mm DIAMETER SERVICE

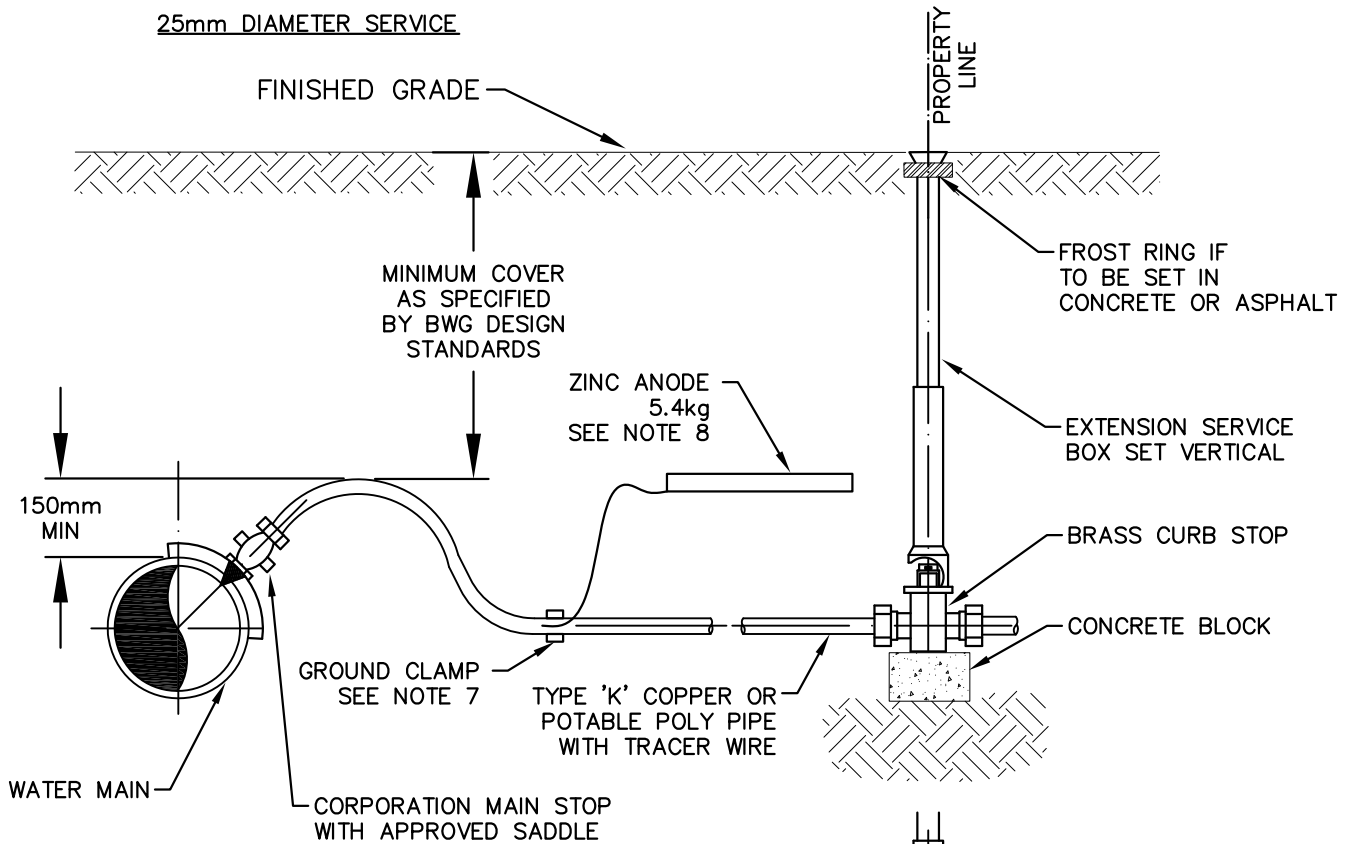

SERVICE LARGER THAN 25mm DIAMETER

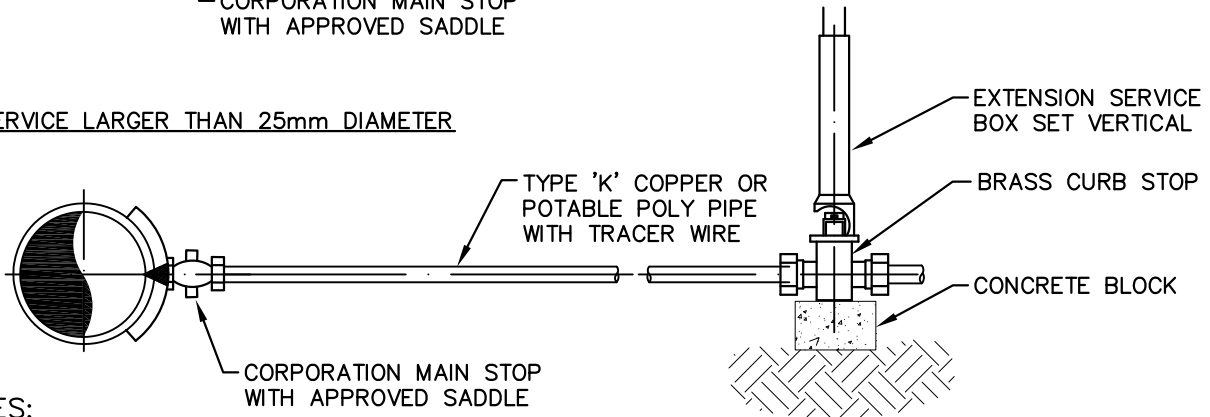

NOTES:

1. ALL SERVICES TO BE AT 90° TO WATER MAIN UNLESS OTHERWISE SPECIFIED.
2. SERVICE DEPTH TO MEET MINIMUM COVER AS SPECIFIED BY BWG DESIGN STANDARDS.
3. NO DIRECT TAPPING OF PVC WATER MAINS. ALL CONNECTIONS TO PVC PIPE TO BE MADE USING AN APPROVED WIDE BAND SERVICE SADDLE.
4. TRACER WIRE TO BE INSTALLED AS PER BWG DESIGN STANDARDS.
5. CATHODIC PROTECTION PER BWG DESIGN STANDARD D113.
6. NO DIRECT TAPING OF DI WATER MAIN. CONNECTIONS TO MADE WITH EPOXY COATED SADDLES C/W STAINLESS STEEL STRAPS.
7. FOR FITTINGS: LOOP AND TIE CABLE TO NUT TO PREVENT STRAIN ON THERMITE WELD DURING BACKFILL.
8. ZINC ANODE IS NOT REQUIRED ON CSA APPROVED POTABLE PLASTIC PIPING.

ALL DIMENSIONS IN MM UNLESS OTHERWISE SPECIFIED

TOWN OF BRADFORD WEST GWILLIMBURY

**WATER SERVICE
CONNECTION**

SCALE: N.T.S.
LAST REVISED: OCT 2014
STD.DWG.

D110